

APPENDIX - VIII

**PROFORMA REGARDING SAFE DRINKING WATER AND SANITARY CONDITION**

**CERTIFICATE.**


No. 605

Date : 16-4-25

It is certified that an inspection team headed by **Assistant Engineer/Junior Engineer Water Supply & Sanitation** inspected **Sant Pranpal Singh Singh Convent School, Rajpur Road, Bhogpur, Jalandhar** on **09-04-2025** and found that this institution has safe drinking water facilities for the students and members of staff of the institution and is maintaining the hygienic sanitation condition in the school building & the campus is satisfactory.

The above valid for a period of **12 Months** w.e.f from Dated 16-04-2025

Signature with Seal:

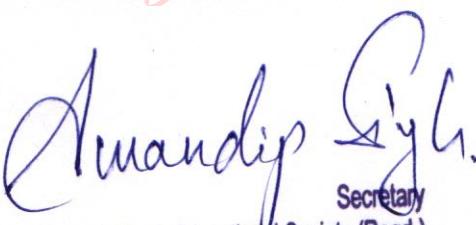


Sub Divisional Engineer  
W/S & Sanitation Sub Div. No. 3  
Jalandhar  
Designation : Sub Divisional Engineer

To

Sant Pranpal Singh Singh Convent School,  
Rajpur Road ,Bhogpur,  
Jalandhar

**AMANDI P SINGH** Digitally signed by  
AMANDIP SINGH  
Date: 2025.06.19  
13:51:22 +05'30'

  
Secretary  
Sant Pranpal Singh Educational Society (Regd.)  
Begowal (Kpt.) Punjab

  
Principal  
Sant Pranpal Singh Convent School  
Bhogpur (Jalandhar) Punjab

# DISTRICT WATER TESTING LABORATORY, JALANDHAR

Water Supply and Sanitation Office, Near Bara Dari, Near DC Office, Jalandhar  
dwtljalandhar@gmail.com

To,

Sant Parapal Singh Convent School, Bhogpur.  
Distt. Jalandhar.

No.: DWTLJAL/2526/00030 Dated : 16/04/2025

Subject : Testing Reports of Water Samples.

Reference: Your Letter/SRF No. SPPS/75/2025/MISC Dated: 08/04/2025

As per above cited subject and reference, Please find enclosed here with the report of 2 Water sample/s received on dated 11/04/2025. It is request to fill the attached feedback form and send it back to District water Testing Laboratory, Jalandhar

D/A : Test Report



Authorized Signatory  
For, District water Testing Laboratory  
Jalandhar

AMANDI  
P SINGH

Digitally signed  
by AMANDIP  
SINGH  
Date: 2025.06.19  
14:07:38 +05'30'

Sant Parapal Singh Educational Society (Regd.)  
Begowal (Kpt.) Punjab



Principal  
Sant Parapal Singh Convent School  
Bhogpur (Jalandhar) Punjab

**DISTRICT WATER TESTING LABORATORY, JALANDHAR**  
Water Supply and Sanitation Office, Near Bara Dari, Near DC Office, Jalandhar  
dwtljalandhar@gmail.com

**Payment Receipt**

Receipt No. : 23878

Date : 15/04/2025

Invoice No. : INV/2526/00030

Invoice Date : 15/04/2025

Received From : Sant Parapal Singh Convent School, Bhogpur.  
Distt. Jalandhar.

The Sum of Rupees : Two Hundred Sixty Only.

In Cash

Rs. : 260.00

Disclaimer: -Payment made by cheque/online mode are subject to clearance by bank.

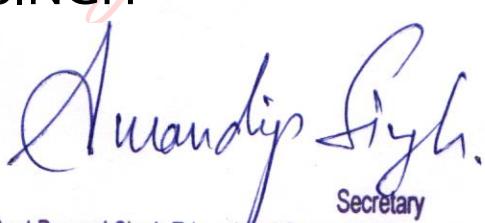



For District water Testing Laboratory, Jalandhar  
Authorized Signatory

AMAND  
IP  
SINGH

Digitally signed  
by AMANDIP  
SINGH  
Date: 2025.06.19  
14:07:57 +05'30'

Page No : 1/1

  
Secretary  
Sant Pranpal Singh Educational Society (Regd.)  
Begowal (Kpt.) Punjab

Principal   
Sant Pranpal Singh Convent School  
Bhogpur (Jalandhar) Punjab

# DISTRICT WATER TESTING LABORATORY, JALANDHAR

Water Supply and Sanitation Office, Near Bara Dari, Near DC Office, Jalandhar  
dwtljalandhar@gmail.com



TC-14420

## TEST REPORT

Name & Address of Customer : Sant Parapal Singh Convent School, Bhogpur. Distt. Jalandhar.		Customer Reference No.	No : SPPS/75/2025/MISC Dated : 08/04/2025
		Sample Submitted by	Sh. Amandeep Singh
		Date of Sample Receipt	11/04/2025
		Analysis Starting Date	15/04/2025
		Analysis completion Date	16/04/2025
Discipline : Chemical Testing		Group: Water	
ULR No.:	TC14420250000241F	Sample Type :	Water
Test Report No.:	DWTLJAL/2526/00030	Date of Issue :	16/04/2025
Registration no.:	DWTLJAL/REG2526/00042	Condition of Sample :	Unsealed
Collection Point:	Private Submersible	Quantity/Type of Bottle:	1000 ml / Amber Coloured Sample Bottle - 500 mL
Scheme/Source:	Not Mentioned(Not Mentioned)	Location/Depth :	Sant Parapal Singh Convent School, Bhogpur, Jalandhar.(P/Sub.) / NA
Village :	Not Mentioned	Habitation :	Not Mentioned
Block:	Not Mentioned	District :	Jalandhar
Latitude :	Not Mentioned	Longitude:	Not Mentioned

Sr. No	Parameter	Result	As per IS-10500:2012 (2nd Rev.)		Unit	Reference Method :
			Acceptable Limit	Permissible Limit		
1	pH	7.87@25°C	6.5-8.5	No Relaxation	--	IS 3025 (Part 11-2022) Electrometric Method
2	Colour	1	5	15	CU	IS 3025 (Part 4-2021) Visual Comparison Method
3	Odour	Agreeable	Agreeable	Agreeable	--	IS 3025 (Part 5 – 2018) (Second Revision)
4	Taste	Agreeable	Agreeable	Agreeable	--	IS 3025 (Part 8 – 2023)
5	TDS	215.0	500	2000	mg/l	IS 3025 (Part 16-2023) Gravimetric Method
6	Turbidity	BDL	1	5	NTU	IS 3025 (Part 10-2023) Nephelometric Method
7	Alkalinity(CaCO <sub>3</sub> )	173.72	200	600	mg/l	IS 3025 (Part 23-2023) Indicator Method
8	Hardness(CaCO <sub>3</sub> )	149.48	200	600	mg/l	IS 3025 (Part 21- 2009)(RA 2023) EDTA Method
9	Calcium(Ca)	37.24	75	200	mg/l	IS 3025 (Part 40-2024) EDTA Titrimetric Method
10	Magnesium(Mg)	13.74	30	100	mg/l	APHA (24th Ed.2023) Method: 3500-Mg+2 B By Calculation Method
11	Chloride(Cl)	17.48	250	1000	mg/l	IS 3025 (Part 32-1988) Argentometric Method

This Report is issued under the following terms & Condition :

1. The results apply to the sample as received only.
2. The sample will be destroyed after retention time unless otherwise specified specially.
3. This report is not to be reproduced wholly or in part and can't be used as evidence in court of law.
4. Abbreviation used (TDS = Total Dissolved Solids, mg/l = milligram per liter, BDL = Below detection limit, APHA = American Public Health Association, IS = Indian Standard, NT = Not Tested, NA = Not Applicable NTU = Nephelometric Turbidity Unit, RA = Reaffirmed, ND=Not Detected)
5. \* Value not available or test not performed for this parameter.
6. Temperature condition limit: 25±5°C and Humidity condition limit: 50 ±20%

Reviewed and Approved By

Mr. Jivesh Kumar  
Quality Manager  
Authorized Signatory  
For, District water Testing Laboratory  
Jalandhar

----- End of the Test Report -----

AMANDI  
P SINGH

Digitally signed by  
AMANDIP SINGH  
Date: 2025.06.19  
14:08:13 +05'30'

*Amansingh Singh*  
Secretary  
Sant Parapal Singh Educational Society (Regd.)  
Begowal (Kpt.) Punjab

*Sharma*  
Principal  
Sant Parapal Singh Convent School  
Bhogpur (Jalandhar) Punjab

# DISTRICT WATER TESTING LABORATORY, JALANDHAR

Water Supply and Sanitation Office, Near Bara Dari, Near DC Office, Jalandhar  
dwtljalandhar@gmail.com



TC-14420

## TEST REPORT

Name & Address of Customer : Sant Paranal Singh Convent School, Bhogpur. Distt. Jalandhar.		Customer Reference No. : No : SPPS/75/2025/MISC Dated : 08/04/2025	
		Sample Submitted by : Sh. Amandeep Singh	
		Date of Sample Receipt : 11/04/2025	
		Analysis Starting Date : 15/04/2025	
		Analysis completion Date : 16/04/2025	
Discipline : Chemical Testing		Group: Water	
ULR No.:	TC144202500000241F	Sample Type :	Water
Test Report No.:	DWTLJAL/2526/00030	Date of Issue :	16/04/2025
Registration no.:	DWTLJAL/REG2526/00043	Condition of Sample :	Unsealed
Collection Point:	Treatment Plant (RO/CWPP/ARP/HH Purifier)	Quantity/Type of Bottle:	1000 ml / Amber Coloured Sample Bottle - 500 mL
Scheme/Source:	Not Mentioned(Not Mentioned)	Location/Depth :	Sant Paranal Singh Convent School, Bhogpur, Jalandhar.(R.O.) / NA
Village :	Not Mentioned	Habitation :	Not Mentioned
Block:	Not Mentioned	District :	Jalandhar
Latitude :	Not Mentioned	Longitude:	Not Mentioned

Sr. No	Parameter	Result	As per IS-10500:2012 (2nd Rev.)		Unit	Reference Method :
			Acceptable Limit	Permissible Limit		
1	pH	8.06@24°C	6.5-8.5	No Relaxation	--	IS 3025 (Part 11-2022) Electrometric Method
2	Colour	1	5	15	CU	IS 3025 (Part 4-2021) Visual Comparison Method
3	Odour	Agreeable	Agreeable	Agreeable	--	IS 3025 (Part 5 – 2018) (Second Revision)
4	Taste	Agreeable	Agreeable	Agreeable	--	IS 3025 (Part 8 – 2023)
5	TDS	110.0	500	2000	mg/l	IS 3025 (Part 16-2023) Gravimetric Method
6	Turbidity	BDL	1	5	NTU	IS 3025 (Part 10-2023) Nephelometric Method
7	Alkalinity(CaCO <sub>3</sub> )	64.64	200	600	mg/l	IS 3025 (Part 23-2023) Indicator Method
8	Hardness(CaCO <sub>3</sub> )	40.4	200	600	mg/l	IS 3025 (Part 21- 2009)(RA 2023) EDTA Method
9	Calcium(Ca)	16.19	75	200	mg/l	IS 3025 (Part 40-2024) EDTA Titrimetric Method
10	Magnesium(Mg)	BDL	30	100	mg/l	APHA (24th Ed.2023) Method: 3500-Mg+2 B By Calculation Method
11	Chloride(Cl)	11.65	250	1000	mg/l	IS 3025 (Part 32-1988) Argentometric Method

This Report is issued under the following terms & Condition :

1. The results apply to the sample as received only.
2. The sample will be destroyed after retention time unless otherwise specified specially.
3. This report is not to be reproduce wholly or in part and can't be used as evidence in court of law.
4. Abbreviation used (TDS = Total Dissolved Solids, mg/l = milligram per liter, BDL = Below detection limit, APHA = American Public Health Association, IS = Indian Standard, NT = Not Tested, NA = Not Applicable NTU = Nephelometric Turbidity Unit, RA = Reaffirmed, ND=Not Detected)
5. \* Value not available or test not performed for this parameter.
6. Temperature condition limit: 25±5°C and Humidity condition limit: 50 ±20%

Reviewed and Approved By

Mr. Jivesh Kumar  
Quality Manager  
Authorized Signatory  
For, District water Testing Laboratory  
Jalandhar

AMANDIP  
SINGH  
Digitally signed by  
AMANDIP SINGH  
Date: 2025.06.19  
14:08:28 +05'30'

End of the Test Report

*Amandip Singh*  
Secretary  
Sant Paranal Singh Educational Society (Regd.)  
Begowal (Kpt.) Punjab

*Sharma*  
Principal  
Sant Paranal Singh Convent School  
Bhogpur (Jalandhar) Punjab